

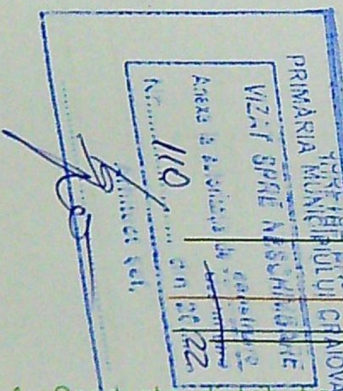


CATEGORIA DE IMPORTANTA A CONSTRUCTIEI:
"C" - CONSTRUCTII DE IMPORTANTA NORMALA

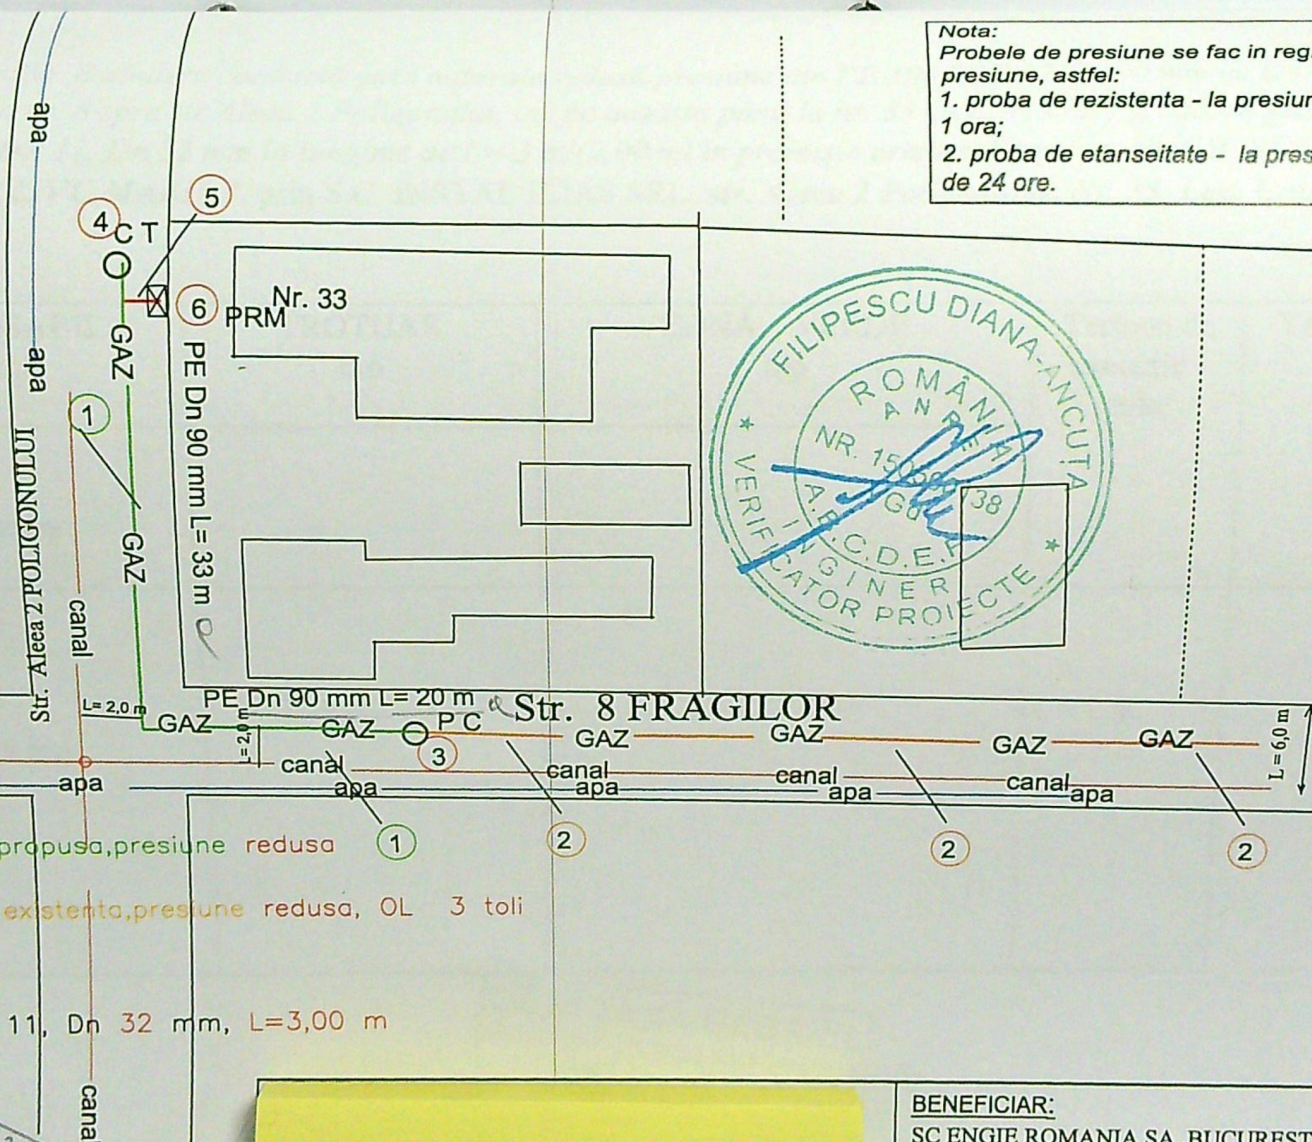

1. Conducta distributie gaze naturale propusa, presiune redusa, PE100, SDR11, Dn90mm, L=53m
2. Conducta distributie gaze naturale existenta, presiune redusa, OL 3 toli
3. P C Punct de cuplare
4. C T Cap trminal
5. Racord proiectat din PE 100 SDR 11, Dn 32 mm, L=3,00 m
6. P R M Post reglare masurare

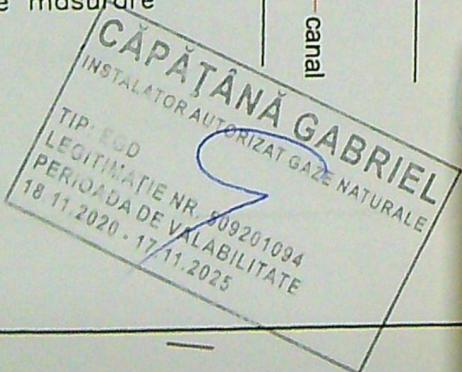

Nota:
Probele de presiune se fac in regim de MEDIE presiune, astfel:
1. proba de rezistenta - la presiune de 9 bar timp de 1 ora;
2. proba de etanseitate - la presiune de 6 bar timp de 24 ore.



BENEFICIAR: SC ENIGIE ROMANIA SA ,BUCURESTI ; ABONAT: CRACIUNESCU LIVIU MARIUS str. Aleea 2 POLIGONULUI ,NR.33	
Titlu proiect: Extindere conducta distributie si Racord gaze CRAIOVA ,JUD.DOLJ	Faza: P.T.
PLAN DE SITUATIE	Plansa nr. G2

